


## GENERAL NOTES

1. ALL WORK SHALL CONFORM AND COMPLY WITH NYC BUILDING CODE C27-348
2. THE WORK REQUIRED UNDER THIS CONTRACT SHALL BE PERFORMED ON NORMAL WORK HOURS TIME UNLESS OTHERWISE REQUIRED BY OTHER CLAUSES OF THIS CONTRACT OR AS DIRECTED BY THE ENGINEER.
3. BEFORE COMMENCING WORK, THE CONTRACTOR SHALL CONFIRM ALL CONDITIONS AND DIMENSIONS IN THE FIELD. ANY ERRORS OR OMISSIONS SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER.
4. BEFORE COMMENCING WORK, THE CONTRACTOR SHALL CONFIRM THE ENGINEER OF ANY AREAS WITHOUT FIREPROOFING. ALL EXPOSED STRUCTURAL STEEL AND CHIPPED-OFF FIREPROOFING SHALL BE PATCHED OR TOUCHED-UP WITH CAFCO TYPE D-C/F" OR APPROVED EQUAL AS DIRECTED BY THE ENGINEER.
5. THE CONTRACTOR SHALL NOT DRILL HOLES INTO EXISTING SLABS OR STRUCTURAL MEMBERS FOR THE PURPOSE OF SUPPORTING ANY LOADS, UNLESS WRITTEN APPROVAL IS OBTAINED FROM THE ENGINEER.
6. THE CONTRACTOR SHALL PROTECT THE PUBLIC OR TENANT SPACE BELOW FROM ANY DAMAGE RESULTING FROM FLOOR DRILLING OPERATION.
7. THE CONTRACTOR SHALL REPAIR OR REPLACE EXISTING CONSTRUCTION DAMAGED IN THE PERFORMANCE OF THIS CONTRACT AT NO COST TO THE AUTHORITY AND TO THE SATISFACTION OF THE ENGINEER.
8. THE SPACE AROUND PIPES, DUCTS, ETC. PENETRATING RATED WALLS, SHALL NOT EXCEED 1/2" AND SHALL BE PACKED SOLID WITH MINERAL WOOL OR APPROVED EQUAL AND BE CLOSED OFF BY CLOSE FITTING METAL ESCUTCHEONS ON BOTH SIDES OF THE PARTITION AS REQUIRED BY NYC BUILDING CODE C27-348
9. FIRESTOPPING SHALL BE AS REQUIRED BY NYC BUILDING CODE C26-504.7.
10. REMOVE AND REPLACE EXISTING TILE AS REQUIRED FOR MECHANICAL, PLUMBING, ETC., INSTALLATIONS.
11. REFERENCE TOWER "A" IS ALSO TOWER ONE AND TOWER "B" IS ALSO TOWER TWO.

## LOCATION PLAN

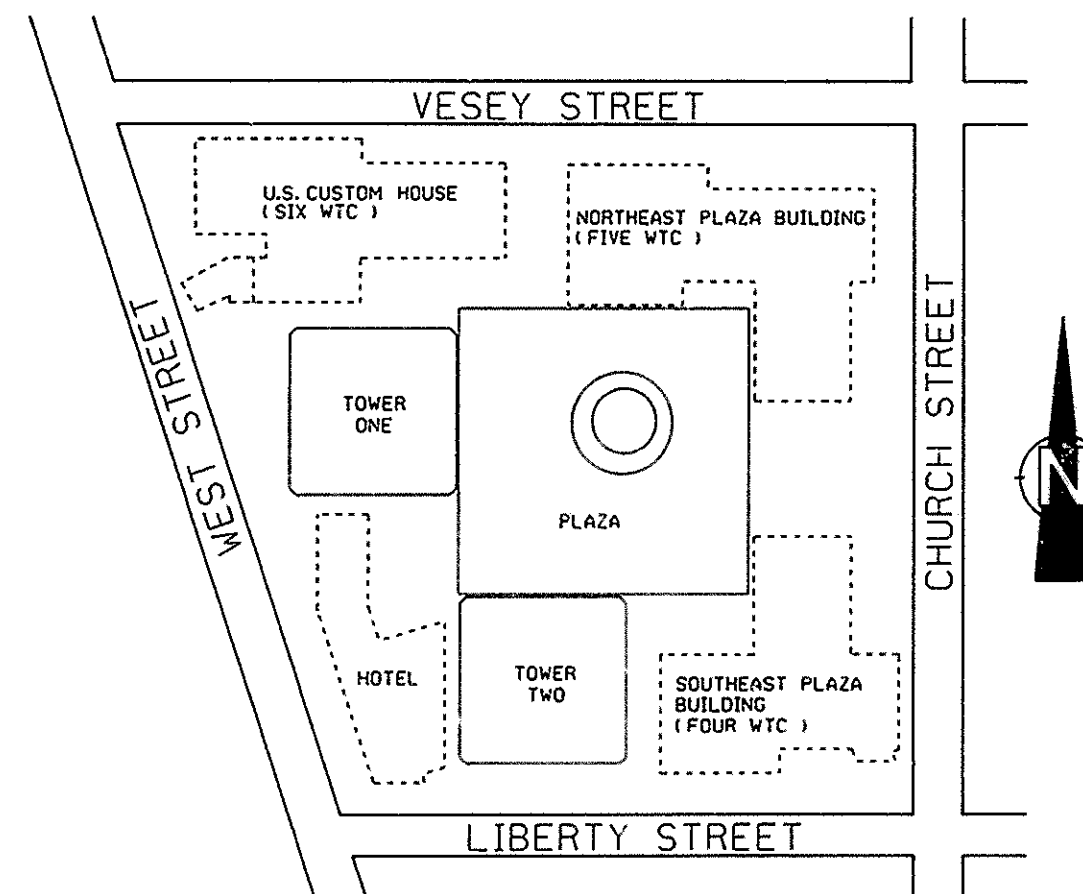

Sheet 3 of 41



THE PORT AUTHORITY  
OF NY & NJ

*[Signature]*  
ENGINEERING PROGRAM MANAGER  
PORT A.C. & T.C. B.A.D.D.  
CHIEF ARCHITECT

*[Signature]*  
Engineering Program Manager

3/15/01 Drawings of Record  
No. Date Revision Approved

Engineering Department  
Design Division

The World Trade  
Center  
Electrical/HVAC  
Upgrade Program

Title  
LOW VOLTAGE DISTRIBUTION

ONE AND TWO WTC

GENERAL NOTES AND  
LOCATION PLAN

This drawing subject to conditions in contract.  
All inventions, ideas, designs and methods  
herein are reserved to Port Authority and  
may not be used without its written consent.

L.V. GALAN J.L. RAMOS L.V. GALAN  
Designed by Drawn by Task Leader

PRINCIPAL ARCHITECT *[Signature]*

Date Scale NO SCALE

Contract Number Drawing Number  
WTC-804.041 T-3

H-278-3